


A3 håndvask

VARE NR.

VVS NR.

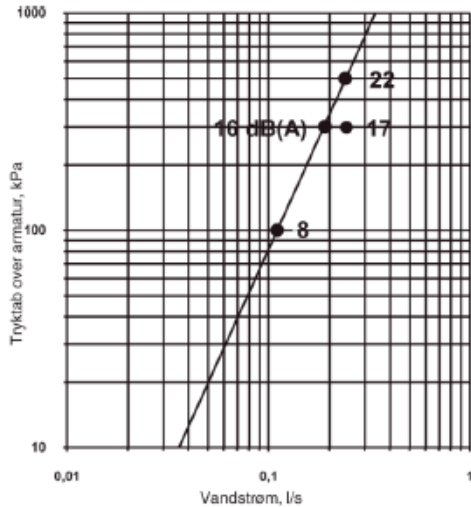

F1114

701923104

F1117

701423XXX


Støjgruppe:
Gruppe 1

Normal vandstrøm:
 $q_n = 0,1$ l/s

Trykgruppe:
Gruppe 150 kPa

Støjniveauet L_{AP} i dB (A) og vandstrøm i afhængighed af tryktabet over armaturet

Flow diagram med spareperlator 5 l/min.

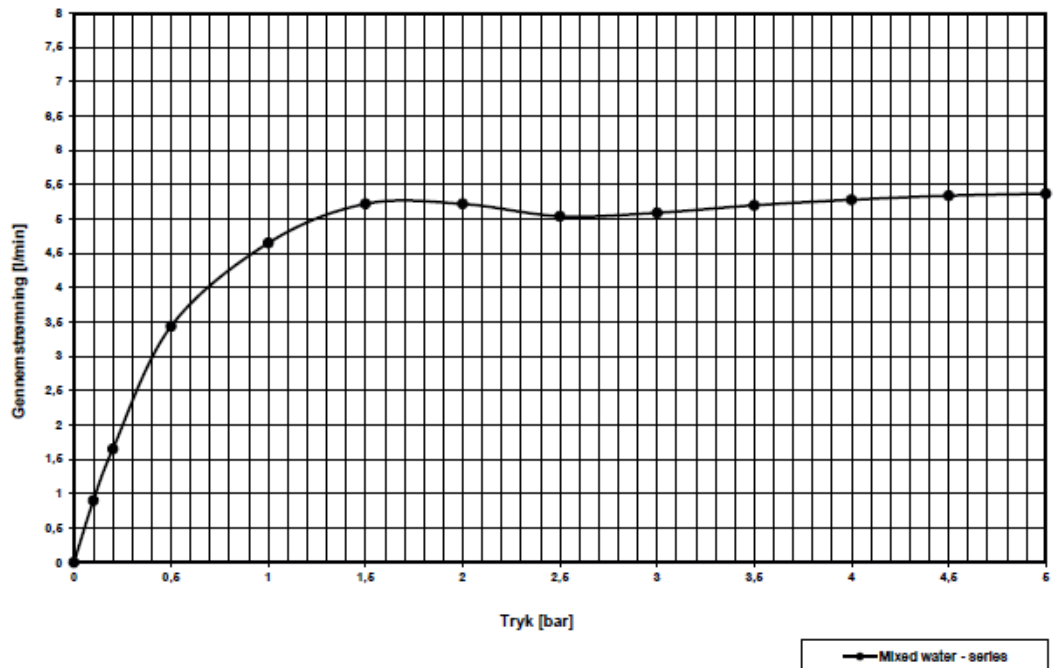

Ideal Standard Produktions-GmbH, Postfach 1340, 54503 Wittlich

Ideal Standard Produktions-GmbH
Röntgenstraße 9
54516 Wittlich, Deutschland

Tel +49 (6571) 16 0
Fax +49 (6571) 16 229

hjschneider@idealstandard.com
www.idealstandardinternational.com

Wittlich, 2. Dezember 2013

DECLARATION OF CONFORMITY

Ideal Standard International BVBA
Corporate Village – Gent Building
Da Vincilaan 2
1935 Zaventem, Belgium

declare under our sole responsibility, that the products Sanitary Fitting:

BORMA

to which this declaration relates is in conformity with the following standard(s)
or other normative documents:

EN 200, EN 248, EN 817, EN 12164, ISO 228,

Material used in Contact with Drinking Water are in accordance with
KTW, W270 or ACS and DIN 50960T6.

.

Best regards

Ideal Standard Produktions-GmbH

Wittlich, den 02.12.2013



Hermann Schneider

Manager Testing & Code Compliance European Fittings